

9.0 Tone Table

TONE	TONE TYPE	TONE DESCRIPTION/ APPLICATION	DIP SWITCH						dBa @ 1m	
			1	2	3	4	5	6		
1	—	970Hz	0	0	0	0	0	0	92	
2	□□□□	800Hz/970Hz @ 2Hz	0	0	0	0	0	1	0	94
3	∕∕∕∕	800Hz – 970Hz @ 1Hz	0	0	0	0	1	0	0	95
4	- - - -	970Hz 1s OFF/1s ON	0	0	0	0	1	1	0	92
5	□□□□	970Hz, 0.5s/ 630Hz, 0.5s	0	0	0	1	0	0	0	92
6	□□□□	554Hz, 0.1s/ 440Hz, 0.4s (AFNOR NF S 32 001)	0	0	0	1	0	1	0	93
7	∕ ∕ ∕	500 – 1200Hz, 3.5s/ 0.5s OFF (NEN 2575:2000 Dutch Slow Whoop)	0	0	0	1	1	0	0	95
8	- - - -	420Hz 0.6s ON/0.6s OFF (Australia AS1670 Alert tone)	0	0	0	1	1	1	0	93
9	∕ ∕ ∕	1000 - 2500Hz, 0.5s/ 0.5s OFF x 3/1.5s OFF (AS1670 Evacuation)	0	1	0	0	0	0	0	97
10	□□□□	550Hz/440Hz @ 0.5Hz	0	1	0	0	0	1	0	94
11	- - - -	970Hz, 0.5s ON/0.5s OFF x 3/ 1.5s OFF (ISO 8201)	0	1	0	1	0	0	0	92
12	- - - -	2850Hz, 0.5s ON/0.5s OFF x 3/1.5s OFF (ISO 8201)	0	1	0	0	1	1	0	90
13	∕∕∕∕	1200Hz – 500Hz @ 1Hz (DIN 33 404)	0	1	1	0	0	0	0	94
14	—	400Hz	0	1	1	0	1	0	92	
15	□□□□	550Hz, 0.7s/1000Hz, 0.33s	0	1	1	1	1	0	0	93
16	∕∕∕∕	1500Hz – 2700Hz @ 3Hz	0	1	1	1	1	1	0	98
17	—	750Hz	1	0	0	0	0	0	0	93
18	—	2400Hz	1	0	0	0	1	1	0	105
19	—	660Hz	1	0	0	1	0	0	0	93
20	- - - -	660Hz 1.8s ON/1.8s OFF	1	0	0	0	1	1	0	93
21	- - - -	660Hz 0.15s ON/0.15s OFF	1	0	1	0	0	0	0	93
22	□□□□	510Hz, 0.25s/ 610Hz, 0.25s	1	0	1	0	1	1	0	92
23	□□□□	800/1000Hz 0.5s each (1Hz)	1	0	1	1	0	0	0	95
24	∕∕∕∕	250Hz – 1200Hz @ 12Hz	1	0	1	1	1	1	0	91
25	∕∕∕∕	500Hz – 1200Hz @ 0.33Hz	1	1	0	0	0	0	0	95
26	∕∕∕∕	2400Hz – 2900Hz @ 9Hz	1	1	0	0	1	1	0	90
27	∕∕∕∕	2400Hz – 2900Hz @ 3Hz	1	1	0	1	1	0	0	90
28	∕ ∕ ∕	500 - 1200Hz, 0.5s/ 0.5s OFF x 3/1.5s OFF (AS1670 Evacuation)	1	1	0	1	1	1	0	93
29	∕∕∕∕	800Hz – 970Hz @ 9Hz	1	1	1	0	0	0	0	95
30	∕∕∕∕	800Hz – 970Hz @ 3Hz	1	1	1	0	1	1	0	95
31	- - - -	800Hz, 0.25s ON/1s OFF	1	1	1	1	1	0	0	92
32	∕ ∕ ∕	500Hz – 1200Hz, 3.75s/0.25s OFF (AS2220)	1	1	1	1	1	1	0	96

EN54-3 (Pending) Compatible Tones are 1,2,3,6,7 & 13.



INSTALLATION & TECHNICAL INFORMATION

PLEASE READ PRIOR TO INSTALLATION



Moflash Intrinsically Safe Sounder/Beacon Range

S00605, Issue 4, 07/06/2017

VISUAL AND/OR AUDIBLE SIGNALLING DEVICES

APPROVALS AND CONFORMITIES



Website: www.moflash.com


Email: technical@moflash.co.uk

1.0 Introduction

The Moflash Intrinsically Safe Sounder-Beacon Range of products (IS-SB-02-xxxx) are ATEX and IECEx certified. This range is approved to be installed in Groups I (Mining) and Group II (above ground), Zones 0, 1 or 2 with gas groups IIA, IIB, IIC and Zones 20, 21 and 22 for dust groups IIIC and carries a temperature classification of T5. The Sounder-Beacon Range has a total of 32 selectable alarm tones via a DIP switch which is set upon installation. This switch also gives the option to change the 1Hz flash signal (Automatically Synchronised to the Sounder Tone) to a static (constantly on) signal. When powered via a suitable Galvanic Isolator or Zener Barrier the Sounder will draw a constant 33mA. The Sounder has diode reverse polarity protection and is also End of Line resistor compatible.

2.0 Intrinsically Safe Labelling

All products will have an individual serial number printed onto the head base plate and on the outside of the base, an example of the Sounder Beacon label is shown below.

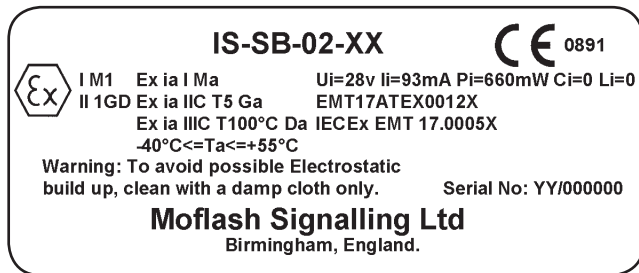

These products have been tested by notified body **Element Materials Technology Warwick Limited** who are UKAS accredited to BS EN ISO/IEC 17025:2005 and ISO/IEC 17065:2012. It is also a Notified Body for the ATEX Directive, an IECEx Certification Body and an IECEx Testing Laboratory.

The suffix X at the end of the certificate numbers indicates that there are special clauses added for safe use of these units.

3.0 Types of Approval and Standards Applied

The Moflash IS product range all have been approved to the following standards:
IEC 60079-0:2011 / EN 60079-0:2012 + A11:2013
IEC 60079-11:2011 / EN 60079-11:2012

8.0 Conditions for Use

The Moflash Intrinsically Safe Signalling Range uses an enclosure rated at IP66. To ensure that this rating is maintained once installed, a suitable cable gland must be used which matches this level of protection. The base of the units contains 3x M20 knockouts for wiring in purposes, and only those required should be used. Any that are removed must have at least an IP66 rated gland fitted with cable passing through it or suitable plug.

The enclosure is non-conducting and may generate an ignition-capable level of electrostatic charge under certain extreme conditions. It is the responsibility of the user to ensure that the equipment is installed in a location where it will not be subjected to external conditions that might cause a build-up of electrostatic charge on the surface of the unit, additionally; cleaning of the equipment should be done only with a damp cloth.

The units must be powered via a suitable Zener Barrier or Galvanic Isolator whose characteristics do not exceed:

U_o:28v, I_o: 93mA, P_o:660mW

A minimum value of U_o should not drop below 23.6v, and I_o should not be below 50mA.

In the Sounder Beacon an additional connection wire may be required between the (1) and (2) pins, this allows the Sounder and the Beacon sections to work with a single input. This wire is to be fitted by the end user. The wire used **MUST** have a minimum radial thickness of 0.5mm of insulation; refer back to Wiring in section 6.

This range of products is only to be powered via a correctly rated Zener Barrier or Galvanic Isolator. To power these units up without the correctly rated barrier could damage these products and so void any protection ratings.

Specific Conditions of Use:

1. Clean equipment regularly to prevent dust build-up with a damp or anti-static cloth only.
2. Equipment only suitable for fixed installation.
3. It must be ensured that the equipment is installed in accordance with IEC 60079-14 and IEC 60079-25 and that capacitance and inductance limits are not exceeded by distributed capacitance (C_c) or distributed inductance (I_c) due to cable length.

Table of Entity Parameters	
Parameter	Barrier Supply
U _i	28V
I _i	93 mA
P _i	660 mW
L _i	0
C _i	0



Picture 1 - Example of Sounder/Beacon being controlled together

If required, an external switch can be wired in series with the (1) and/or (2) connections to give independent remote sounder/beacon activations. This switch must conform to Intrinsically Safe installation (EN 60079-0:2012 + A11:2013, EN 60079-11:2012, EN 50303:2000).

7.0 Maintenance

Little or no maintenance is required during the normal working life of the product. The Moflash Intrinsically Safe enclosures are resistant to most acids, alkalis and chemicals and have been designed to withstand severe weather conditions. However it is suggested that continuous supervision and periodic inspections may be required in relation to the requirements of the installation as per IEC 60079-17. To avoid the possibility of a potential electrostatic charge build up, it is recommended that the exterior of the product is periodically wiped down with a clean damp cloth. At this point a visual inspection is recommended to ensure that the product is in good working order and no damage has been sustained during its normal operation. In the case of dust fibres or flyings, the level of supervision may influence the inspection and maintenance requirements

4.0 Zones, Gas Groups and Temperature Classifications

The Moflash Intrinsically Safe Sounder Beacon Range is certified to the following:

Ex ia IIC T5 Ga, Ex ia IIIC T100C Da, Ex ia I Ma.

This means that the units can be installed in locations with the following conditions when connected to an approved system:

Zones

Zone 0	Explosive gas air mixture continuously present.
Zone 1	Explosive gas air mixture likely to occur in normal operation.
Zone 2	Explosive gas air mixture not likely to occur, and if it does, it will only exist for a short time.
Zone 20	Explosive dust air mixture is continuously present.
Zone 21	Explosive dust air mixture likely to occur in normal operation.
Zone 22	Explosive dust air mixture not likely to occur, and if it does, it will only exist for a short time.

Gas Groupings

IIA Propane Group, IIB Ethylene Group and IIC Hydrogen and Acetylene
M1 Methane, Carbon Dust

Equipment Category

1GD & M1 Temperature Range: $-40^{\circ}\text{C} < T_a < 55^{\circ}\text{C}$

Dust

IIIA Fibres and Flying, IIIB Flour and Grain, IIIC Coal Dust and Metal Dust.


The maximum surface temperature of operating product in this range will not exceed 100°C .

A Declaration of Conformity and also the Sounder Beacon ATEX and IECEx Certificates are available on request or alternately visit www.Moflash.co.uk.

5.0 Installation

The TimeSaver base enables quick and easy installation of these unit with no extra cabling to be made to the head of the unit. Connections are made to the base during the initial wiring phase which results in faster and more reliable installation. The sounder head ‘twists and clicks’ into the base on commissioning thus avoiding any wiring and connection problems associated with traditional installations.

If required, the mechanism for locking the sounder to the base can be activated by removing the thin section of plastic shown in Fig. 1 with side cutters or a similar tool. To open a locked head, remove the small rubber bung from the hole on the side of the sounder, insert a tool into the hole and depress the clip whilst twisting the head. The O-ring and bung must be re-fitted to maintain the weatherproofing.

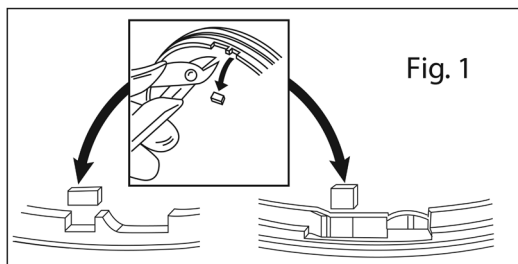


General Requirement

The product must be installed in accordance with the latest EN60079-0 specification or the equivalent IEC specification. With consideration for any local installation requirements and should only be carried out by appropriately competent and qualified personnel.

- The location of the unit should be chosen with due regard to the area over which the signalling device must be visible and/or audible.
- These units are suitable for wall or ceiling mount **only**.
- Environmental exposure conditions during installation should be dry. Moist or wet conditions should be avoided.
- Avoid mounting the beacon where it will be subject to excessive vibration.

To mount the unit

- Remove the head from the base by rotating anticlockwise until it comes free.
- Remove the appropriate fixing hole and conduit knockouts from the back box.
- The back box (shown here) provides IP66 protection, for this to be maintained suitable seals must be used around the mounting screws. Suitably rated (minimum IP66) M20 cable glands must also be used for cable entry/exit.

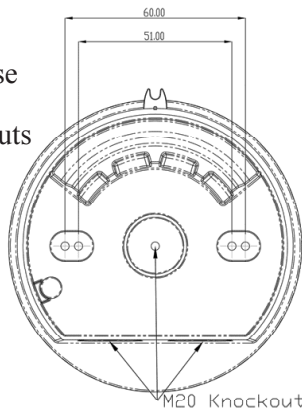

- Select required wiring option for required operation (see wiring section).
- Select tone (See tone table page 8) and light output (See table below) by configuring the DIP switches in the head unit

Light Output	Switch 6 Position
Flashing	OFF
Static	ON

- Relocate head onto mounted base unit & rotate clockwise until locked in place.

6.0 Wiring

Line	Terminal Marking
Common Positive Supply IN	(3) IN+
Sounder Negative Supply	(2) -
Beacon Negative Supply	(1) 🎵/☀

Table above indicates markings inside the base of the unit for wiring connections. Each unit must be powered via an approved Zener Barrier or Galvanic Isolator with figures that do not exceed: **Uo:28v, Io: 93mA, Po:660mW, Ci:0, Li:0**

The combined Sounder Beacon can be operated in 3 ways, Sounder only, Beacon only or Sounder and Beacon combined. This is shown in the table below:

Line	Terminal Marking	Beacon Active	Sounder Active	Both Active
Common Positive Supply IN (Uo)	(3) IN+	+	+	+
Sounder Negative Supply	(2) -		-	-
Beacon Negative Supply	(1) 🎵/☀	-		-

In the “Both Active” column (see table above), terminals (1) and (2) are connected to “-“, this is done using a wire link (supplied by the customer) in the base of the unit (see picture 1 on page 6). This wire must conform to correct standards as required by the Intrinsically Safe installation (EN 60079-0:2012 + A11:2013, EN 60079-11:2012, EN 50303:2000), minimum wire gauge of 24AWG copper wire required.

When the beacon is set to “Static” mode (DIP Switch 6 on), the Beacon will be active when either the Beacon Negative supply or Sounder Negative supply is connected.

End of line monitoring is applicable to the Sounder Beacon Product Range. For this to function correctly the resistor must be connected between the IN+ terminal and either the Sounder Negative Supply or the Beacon Negative Supply.